



Rapor No/Report No:20200629155412
FİLKİM FİLTRE VE KİMYA SAN. TİC. A.Ş.
TEST RAPORU: HAVA ÜRETEN HVAC PERFORMANS DOĞRULAMASI TEST RAPORU
(PRO AIR CLEAN 175 MOBİL HAVA TEMİZLEME CİHAZI)
TEST REPORT: AIR GENERATING HVAC PERFORMANCE VERIFICATION TEST REPORT

UGM-DF-590-340-100-AX03 (0,3 Mikron (P/ m³) –zaman) Grafiği

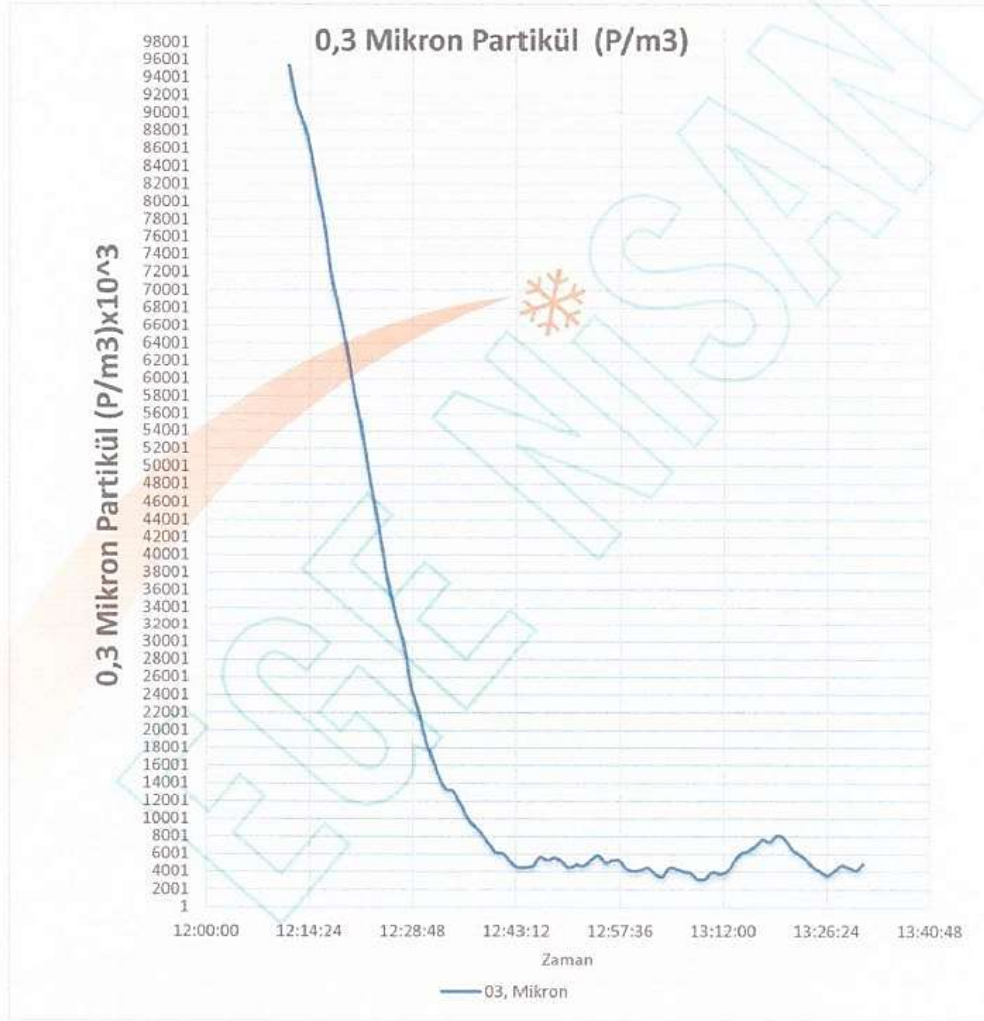

Rapor No/Report No:20200629155412
FİLKİM FİLTRE VE KİMYA SAN. TİC. A.Ş.
TEST RAPORU: HAVA ÜRETEN HVAC PERFORMANS DOĞRULAMA TEST RAPORU
(PRO AIR CLEAN 175 MOBİL HAVA TEMİZLEME CİHAZI)
TEST REPORT: AIR GENERATING HVAC PERFORMANCE VERIFICATION TEST REPORT

UGM-DF-590-340-100-AX03 (0,5 Mikron (P/ m³) –zaman) Grafiği

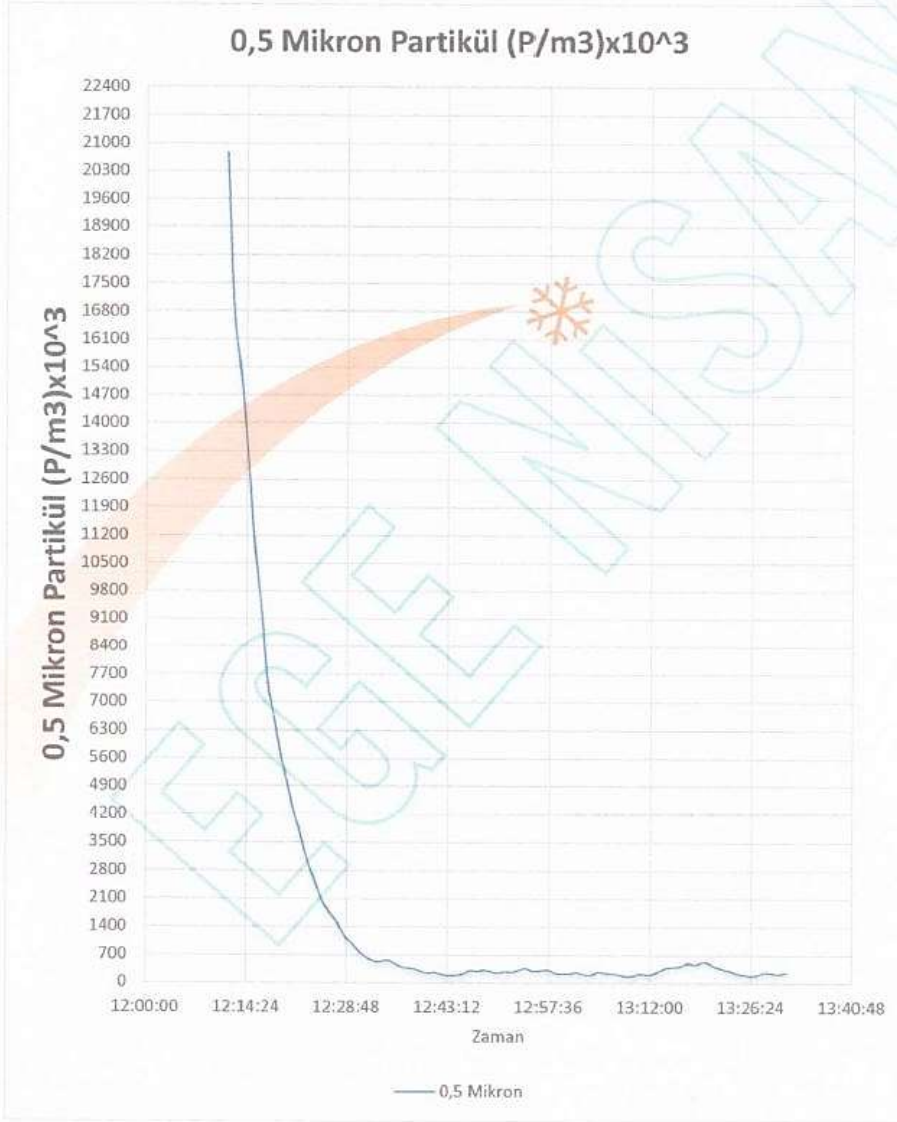


Rapor No/Report No:20200629155412

FİLKİM FİLTRE VE KİMYA SAN. TİC. A.Ş.

TEST RAPORU: HAVA ÜRETEK HVAÇ PERFORMANS DOĞRULAMA TEST RAPORU
(PRO AIR CLEAN 175 MOBİL HAVA TEMİZLEME CİHAZI)


TEST REPORT: AIR GENERATING HVAC PERFORMANCE VERIFICATION TEST REPORT

UGM-DF-590-340-100-AX03 (1 Mikron (P/ m³) –zaman) Grafiği

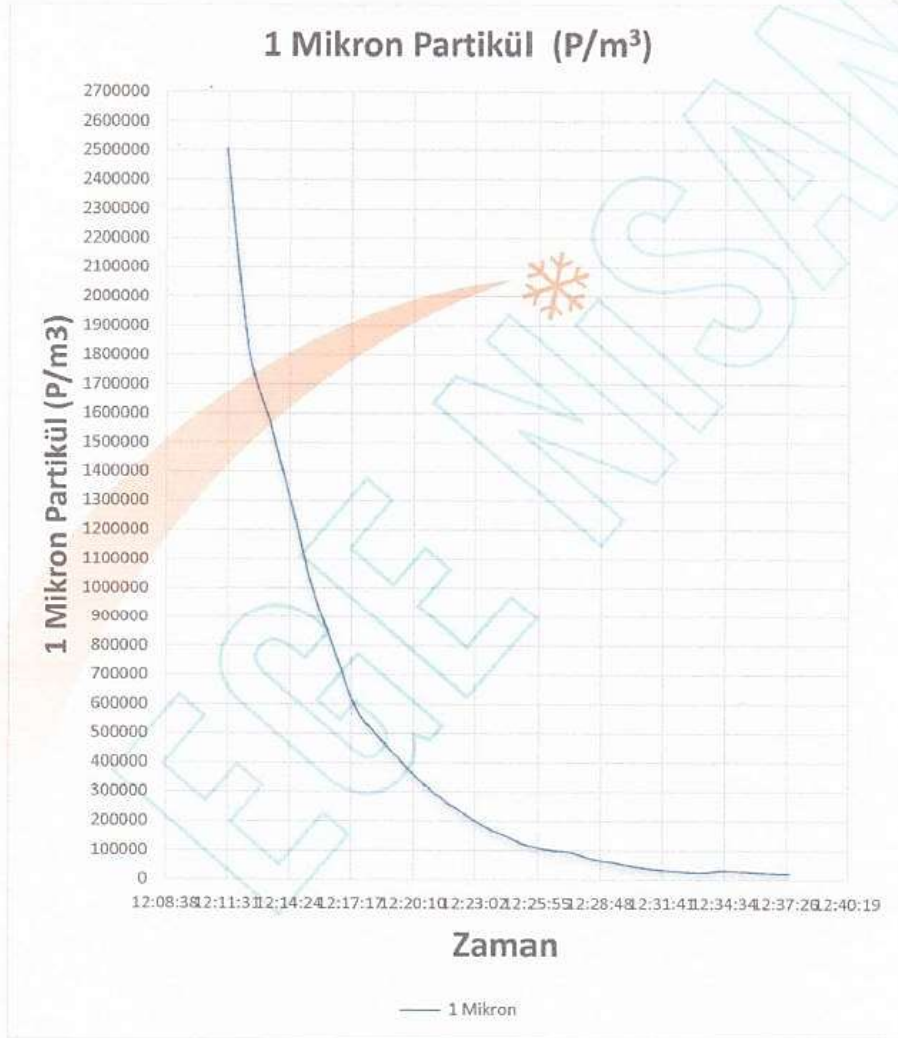

Rapor No/Report No:20200629155412
FİLKİM FİLTRE VE KİMYA SAN. TİC. A.Ş.
TEST RAPORU: HAVA ÜRETEEN HVAC PERFORMANS DOĞRULAMASI TEST RAPORU
(PRO AIR CLEAN 175 MOBİL HAVA TEMİZLEME CİHAZI)
TEST REPORT: AIR GENERATING HVAC PERFORMANCE VERIFICATION TEST REPORT

UGM-DF-590-340-100-AX03 (3 Mikron (P/ m³) -zaman) Grafiği

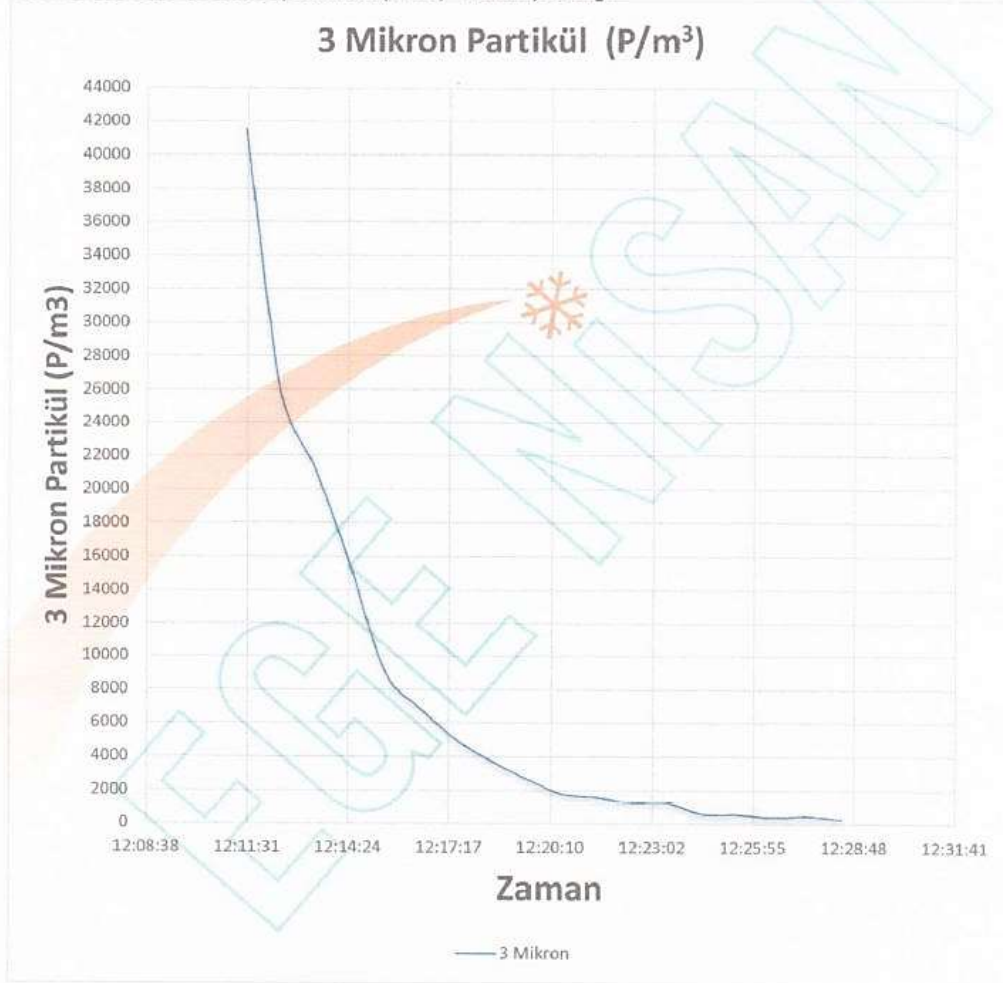

Rapor No/Report No:20200629155412
FİLKİM FİLTRE VE KİMYA SAN. TİC. A.Ş.
TEST RAPORU: HAVA ÜRETEN HVAC PERFORMANS DOĞRULAMASI TEST RAPORU
(PRO AIR CLEAN 175 MOBİL HAVA TEMİZLEME CİHAZI)
TEST REPORT: AIR GENERATING HVAC PERFORMANCE VERIFICATION TEST REPORT

UGM-DF-590-340-100-AX03 (5 Mikron (P/ m³) -zaman) Grafiği

